



BACKFLOW PREVENTION DEVICE SLEEVE

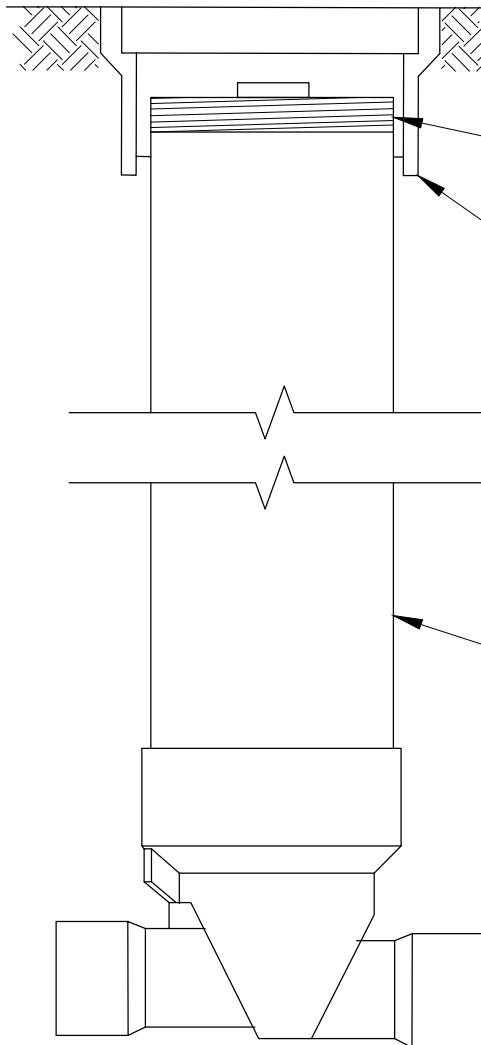


4" ABS/PVC BACKFLOW PREVENTION DEVICE

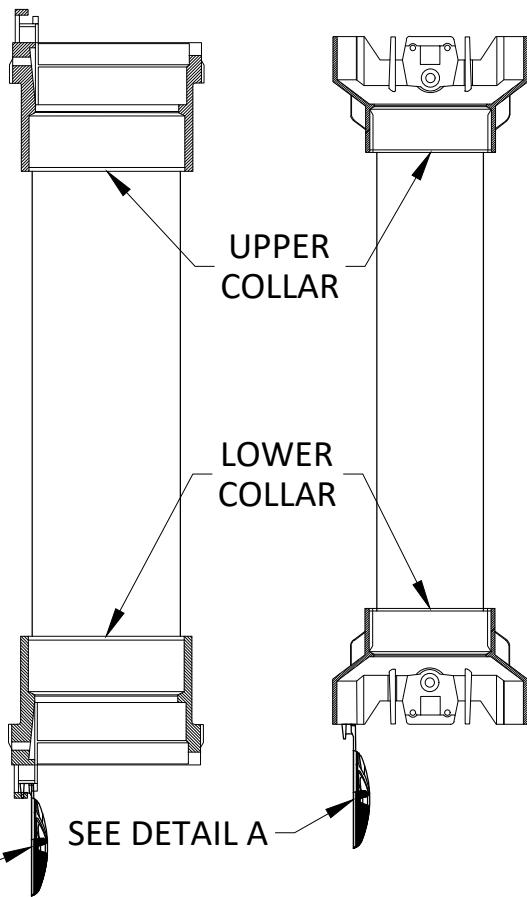

6" PVC BACKFLOW PREVENTION DEVICE

FLAPPER VALVE DETAIL DETAIL A



GENERAL NOTES:

1. REFER TO STANDARD S-1, "SANITARY SEWER CONNECTION," FOR PLACEMENT OF BACK-FLOW PREVENTION DEVICE AND SEWER LATERAL REQUIREMENTS.
2. USE CHRISTY TYPE F1 VALVE BOX WITH F8D LID OR EQUAL. IN DRIVEWAY, USE CHRISTY TYPE G5 TRAFFIC BOX WITH G5C LID OR EQUAL. THE LID SHALL BE MARKED "SEWER".

CITY OF MILLBRAE * STANDARD PLANS

NO.	REVISIONS		DATE	ABS & PVC EXTENDABLE BACK-FLOW PREVENTION DEVICE	APPROVED City Engineer
DRAWN	CK	CHECKED	NT		
DATE	03/2024		SCALE	NTS	SHEET 1 OF 1
DWG. NO.	S-10				