


FIRST SECTION OF LATERAL PIPE MAX LENGTH 18". TRIM LATERAL PIPE FLUSH WITH INSIDE FACE OF MAIN PIPE. FINISH SMOOTH WITH MORTAR.

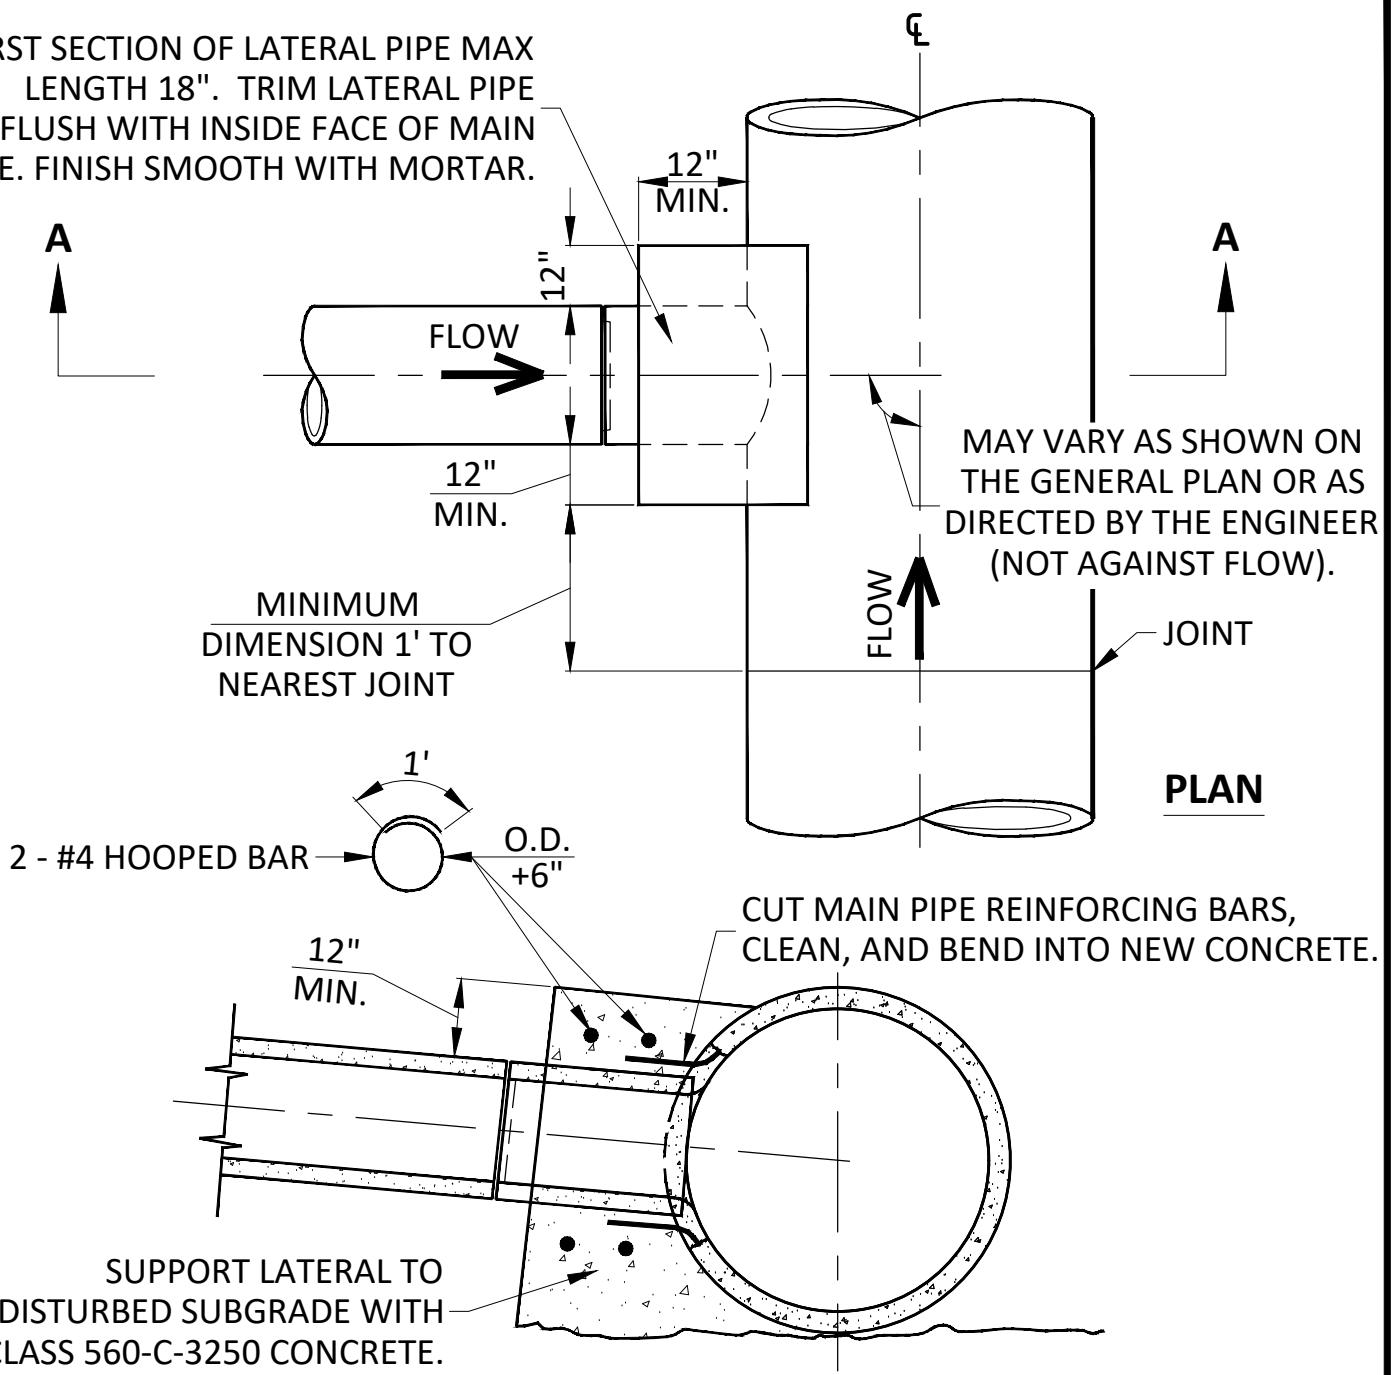

NOTES:

1. INSIDE DIAMETER OF LATERAL SHALL BE NOT LARGER THAN 1/3 OF INSIDE DIAMETER OF MAIN PIPE.
2. CONCRETE MUST SET 24 HRS. MIN. PRIOR TO INSTALLING REMAINING PIPELINE TO AVOID SHOVING FIRST SECTION INTO MAIN. CONNECTION SHALL BE APPROVED BY CITY ENGINEER PRIOR TO INSTALLATION OF REMAINING PIPE.
3. DIAMOND CORE DRILL AND NEOPRENE COMPRESSION CONNECTION ("TAP TITE" OR APPROVED EQUAL) PREFERRED. INSTALL IN PRESENCE OF CITY ENGINEER.
4. LATERAL CLEANOUT ACCESS SHALL BE PROVIDED WITHIN 60 FEET OF CONNECTION TO MAIN.
5. RESURFACING AND BACKFILL PER DWGS. R-9 & R-10.

CITY OF MILLBRAE * STANDARD PLANS

NO.	REVISIONS	DATE	REINFORCED CONCRETE PIPE SIDE CONNECTION				APPROVED				
DRAWN	CK	CHECKED	NT	DATE	03/2024	SCALE	NTS	SHEET	1 OF 1	DWG. NO.	D-8
 City Engineer											