


### CITY OF MILLBRAE \* STANDARD PLANS

NO.	REVISIONS		DATE	STORM WATER FIELD INLET	APPROVED _____ City Engineer
DRAWN	CK	CHECKED	NT		
				DATE 03/2024	SCALE NTS
				SHEET 1 OF 2	DWG. NO. <b>D-3.1</b>

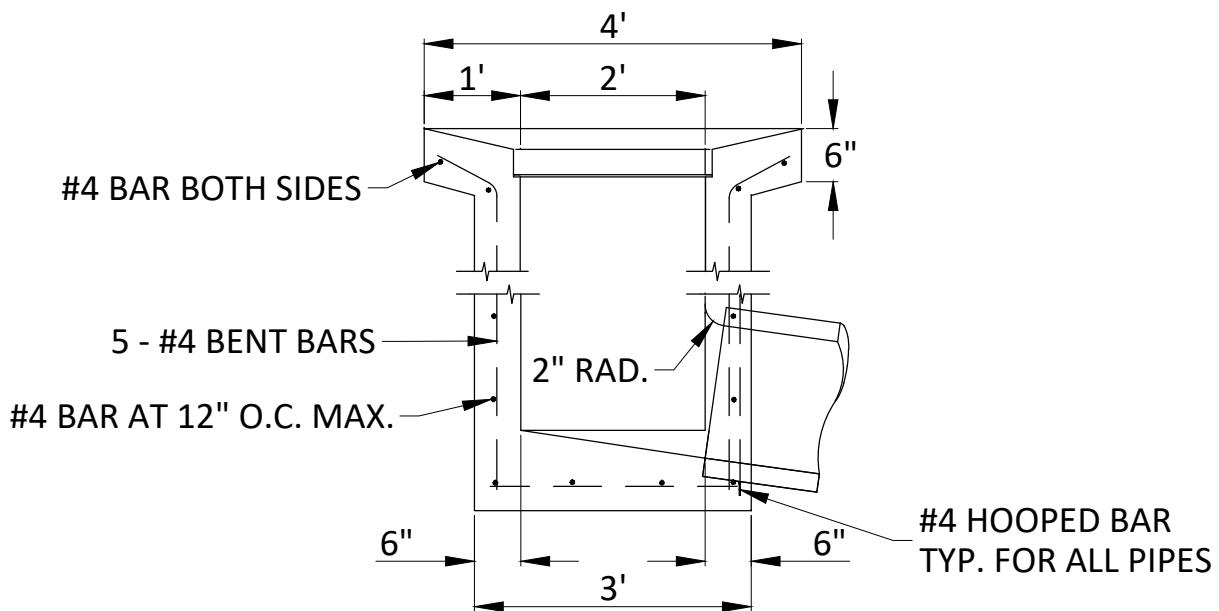

### **SECTION B-B**

#### **GENERAL NOTES:**

1. LOCATION AND DIRECTION OF PIPE ENTERING AND LEAVING INLETS ARE SHOWN ON THE GENERAL PLANS.
2. REINFORCING STEEL MAY BE BENT, CUT, OR SPREAD AS DIRECTED BY THE CITY ENGINEER TO PERMIT CONNECTION OF LATERAL PIPE.
3. ALL CONSTRUCTION JOINTS SHALL BE KEYED.
4. FOR FRAME AND GRATE DETAILS REFER TO DWG. D-1.
5. BOX WALL AND BOTTOM SHALL BE 8" THICK WHEN DIFFERENCE IN ELEVATION BETWEEN GUTTER GRADE AND PIPE FLOW LINE IS 8' OR GREATER.

#### **CITY OF MILLBRAE \* STANDARD PLANS**

NO.	REVISIONS		DATE	STORM WATER FIELD INLET	APPROVED _____ City Engineer
DRAWN	CK	CHECKED	NT	DATE 03/2024	SCALE NTS
					SHEET 2 OF 2
					DWG. NO. <b>D-3.2</b>