
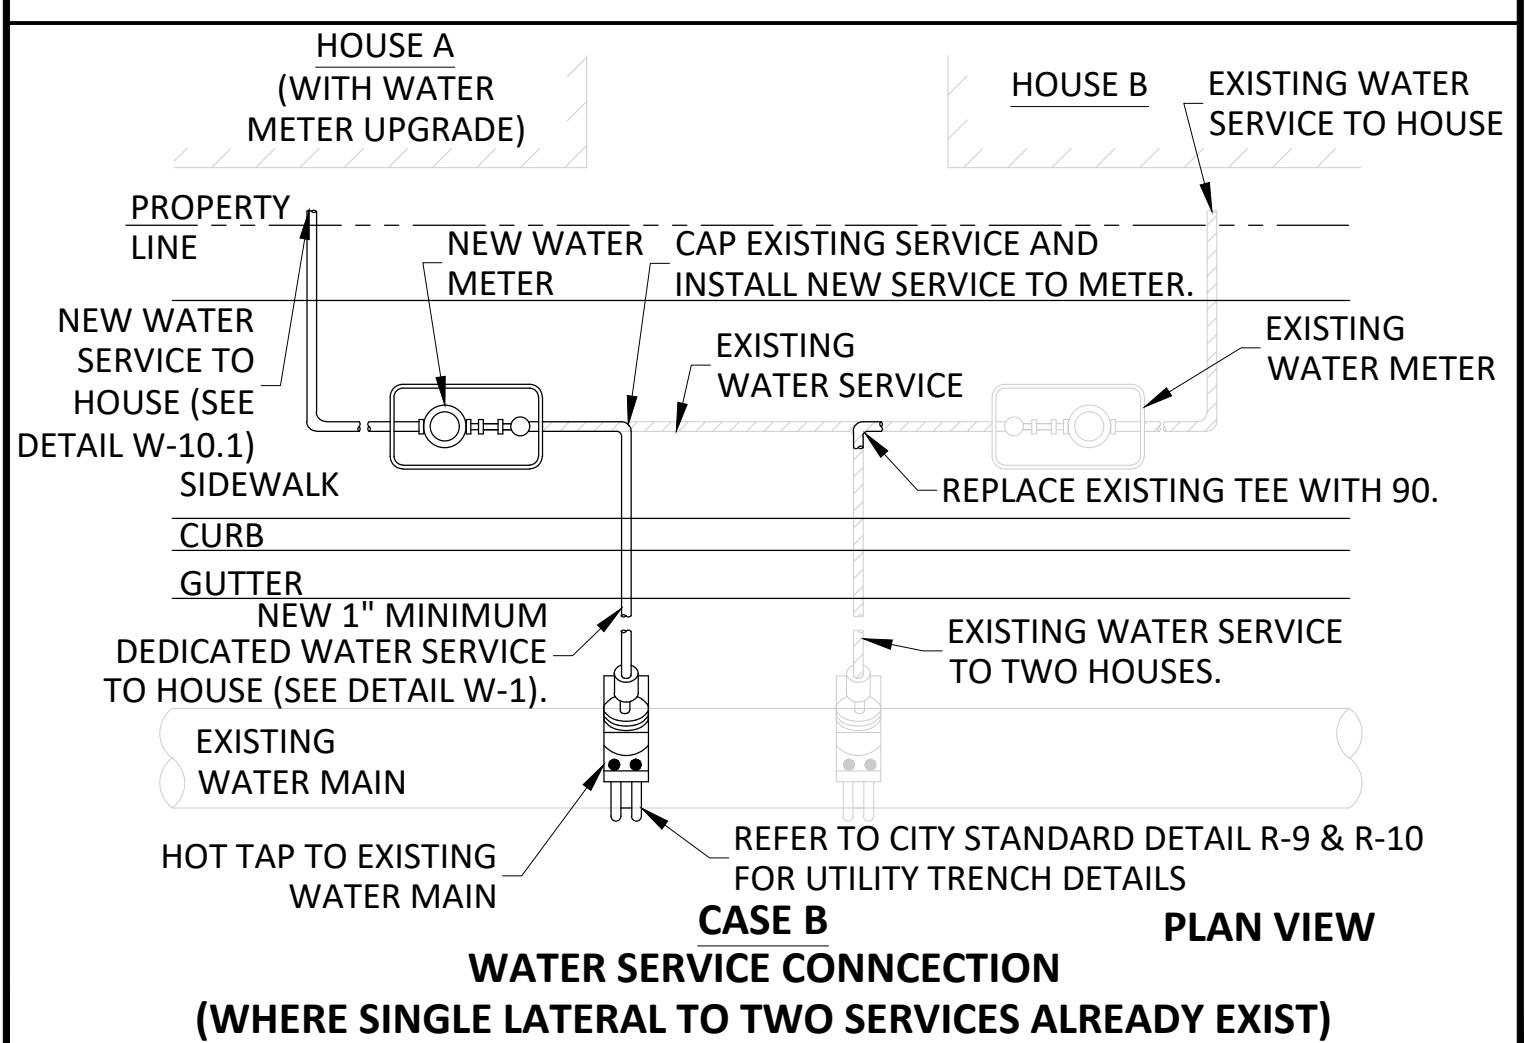


## NOTES:

1. REFER TO STANDARD DETAIL W-1 FOR WATER SERVICE CONNECTION.
2. REFER TO STANDARD DETAIL W-4 FOR BACKFLOW PREVENTER ASSEMBLY.
3. REFER TO STANDARD DETAIL W-10.2 FOR REQUIREMENT OF SINGLE LATERAL FOR HOUSES WITH A FIRE SPRINKLER SYSTEM.
4. ALL BACKFLOW PREVENTER ASSEMBLIES MUST BE APPROVED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA (USC) AND TESTED BY A SAN MATEO COUNTY CERTIFIED TESTER BEFORE APPROVAL OF THE WATER SYSTEM. REFER TO THE SAN MATEO COUNTY WEB SITE FOR APPROVED LIST OF CERTIFIED TESTERS. FOR ADDITIONAL INFORMATION ON USC APPROVED DEVICES PLEASE CONTACT PUBLIC WORKS DEPARTMENT • UTILITIES & OPERATIONS AT (650) 259-2374.
5. TO DETERMINE THE WATER SERVICE AND METER SIZE, CONTACT PUBLIC WORKS DEPARTMENT. ENGINEERING AT (650) 259-2339.

## CITY OF MILLBRAE \* STANDARD PLANS

NO.	REVISIONS		DATE	TYPICAL RESIDENTIAL WATER SERVICE DETAIL (WITH FIRE SYSTEM)	APPROVED _____ City Engineer			
DRAWN	CK	CHECKED	NT	DATE 03/2024	SCALE NTS			
					SHEET 1 OF 2			
					DWG. NO. <b>W-10.1</b>			

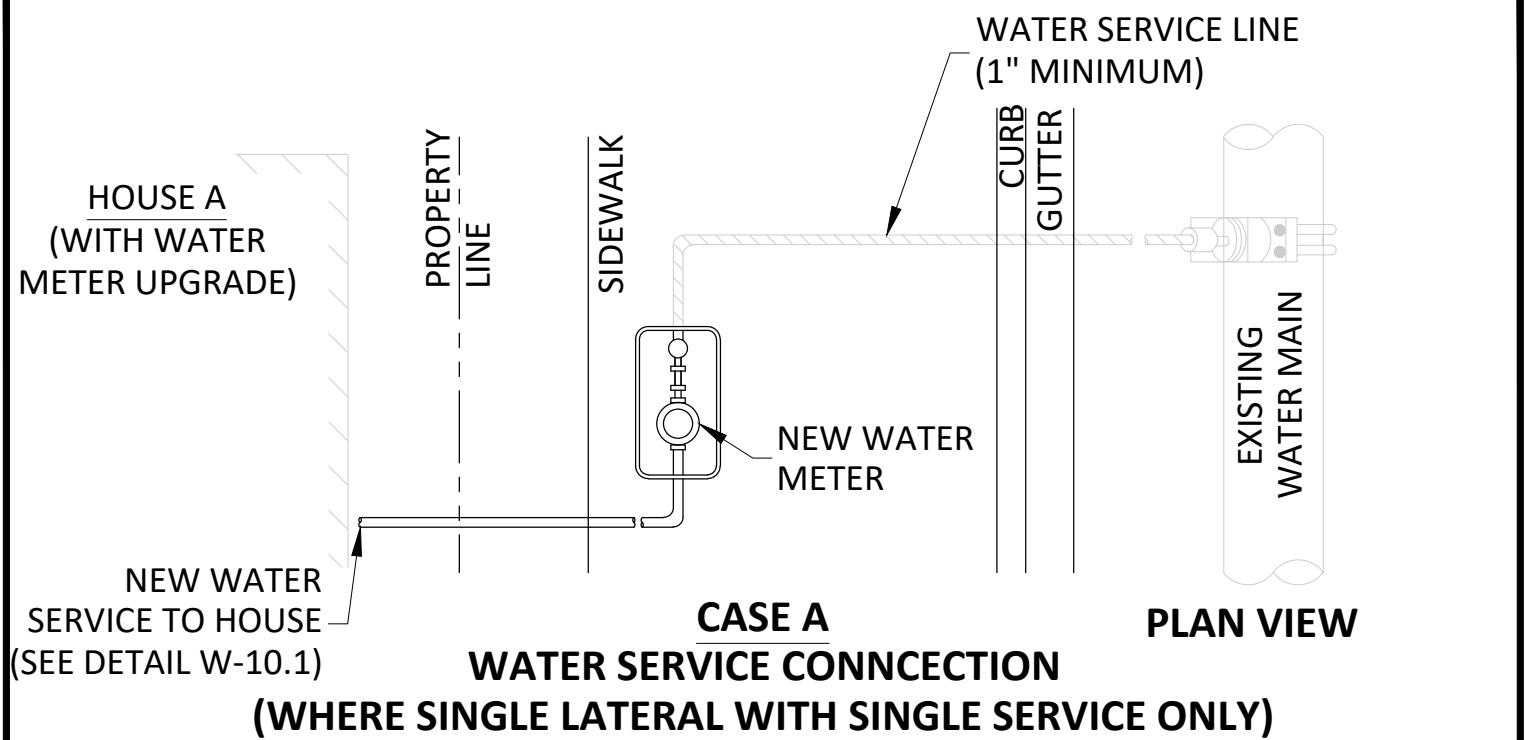

## **CITY OF MILLBRAE \* STANDARD PLANS**

NO.	REVISIONS		DATE	TYPICAL RESIDENTIAL WATER SERVICE DETAIL (WITH FIRE SYSTEM)				APPROVED				
DRAWN		CK	CHECKED	NT	DATE	03/2024	SCALE	NTS	SHEET	2 OF 2	DWG. NO.	<b>W-10.2</b>
City Engineer												