


THRUST BLOCK DIMENSIONS

d	A	B	C	D	CU. FT.
6"	24"	12"	12"	6"	2
8"	28"	14"	14"	8"	4
10"	32"	16"	16"	10"	6
12"	36"	18"	18"	12"	9
14"	40"	20"	20"	14"	13

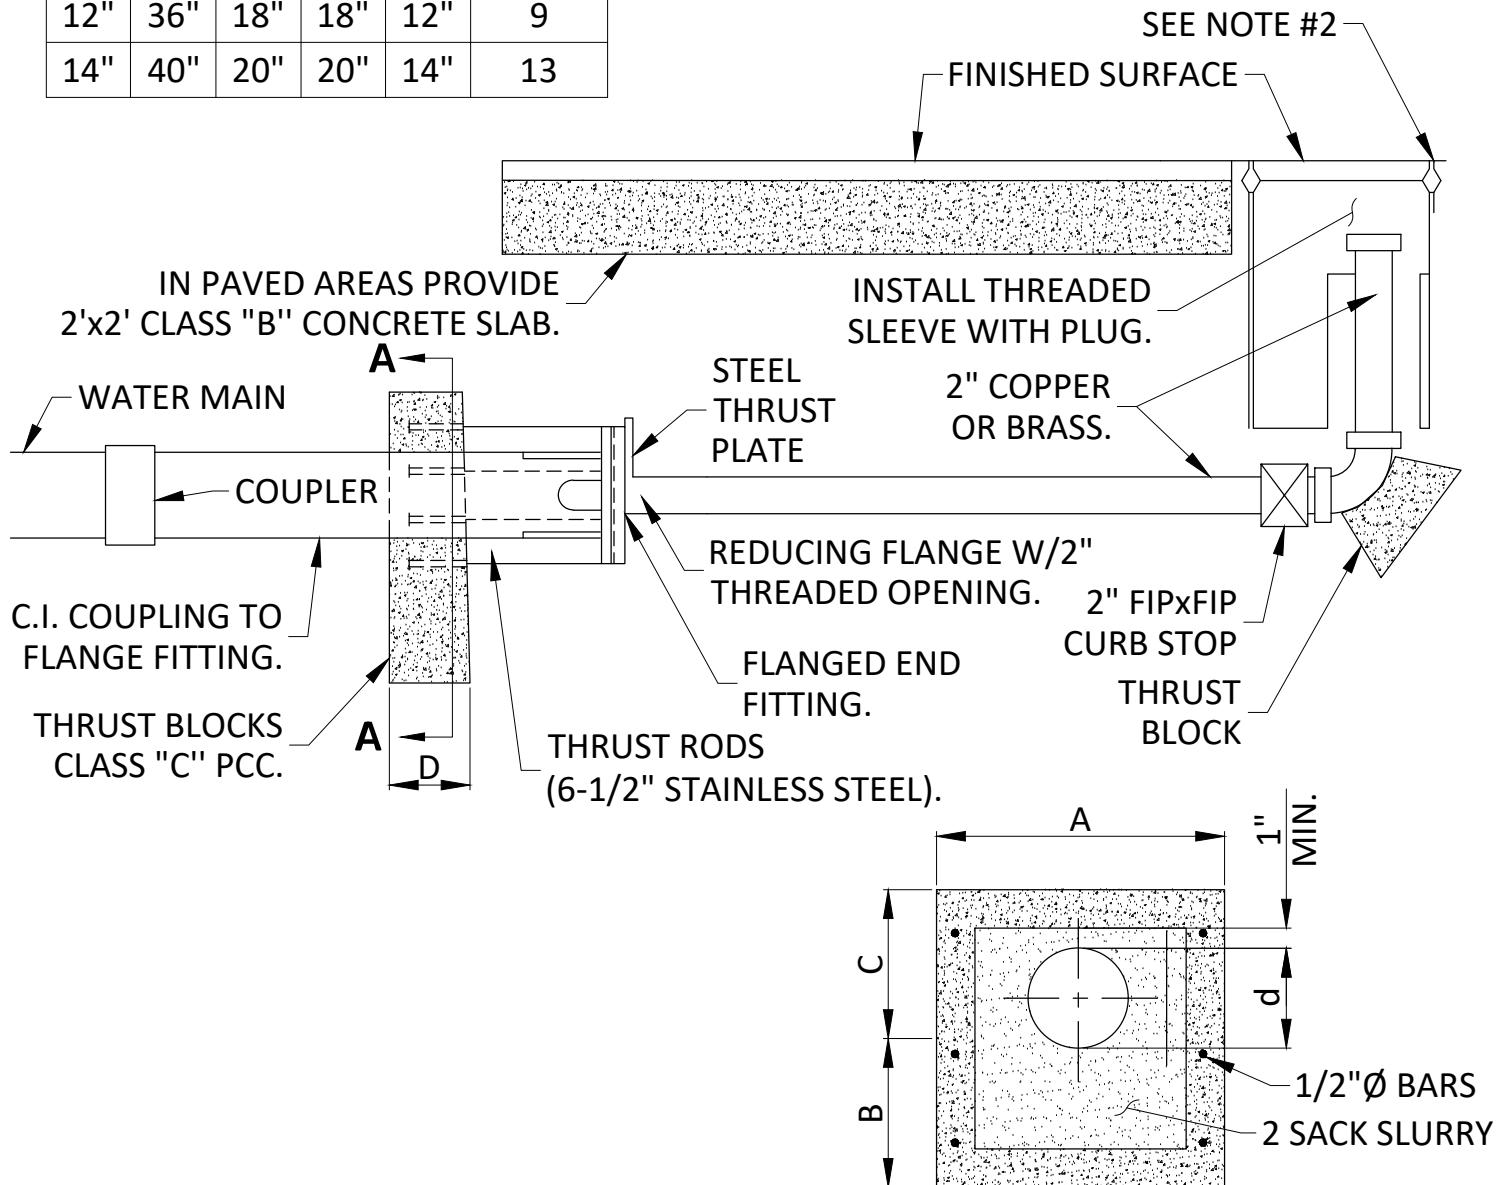

NOTE:

1. TO BE USED WITH SPECIAL APPROVAL OF CITY ENGINEER. IN GENERAL, A FIRE HYDRANT SHALL BE INSTALLED AT THE END OF A DEAD-END LINE.
2. CHRISTY BOX SHALL BE TYPE B9. COVER SHALL BE H2O RATED FOR TRAFFIC LOADING.

SECTION A-A

CITY OF MILLBRAE * STANDARD PLANS

NO.	REVISIONS		DATE	STD. BLOW-OFF FOR DEAD-ENDS	APPROVED _____ City Engineer	
DRAWN	CK	CHECKED	NT			
DATE	03/2024		SCALE	NTS	SHEET	1 OF 1
DWG. NO.					W-7	