


## NOTE:

ALLOW A MINIMUM 18" OF DRIPLINE HOSE IN VALVE BOX IN ORDER TO DIRECT FLUSHED WATER OUTSIDE VALVE BOX.


## **DRIPLINE-FLUSH POINT**

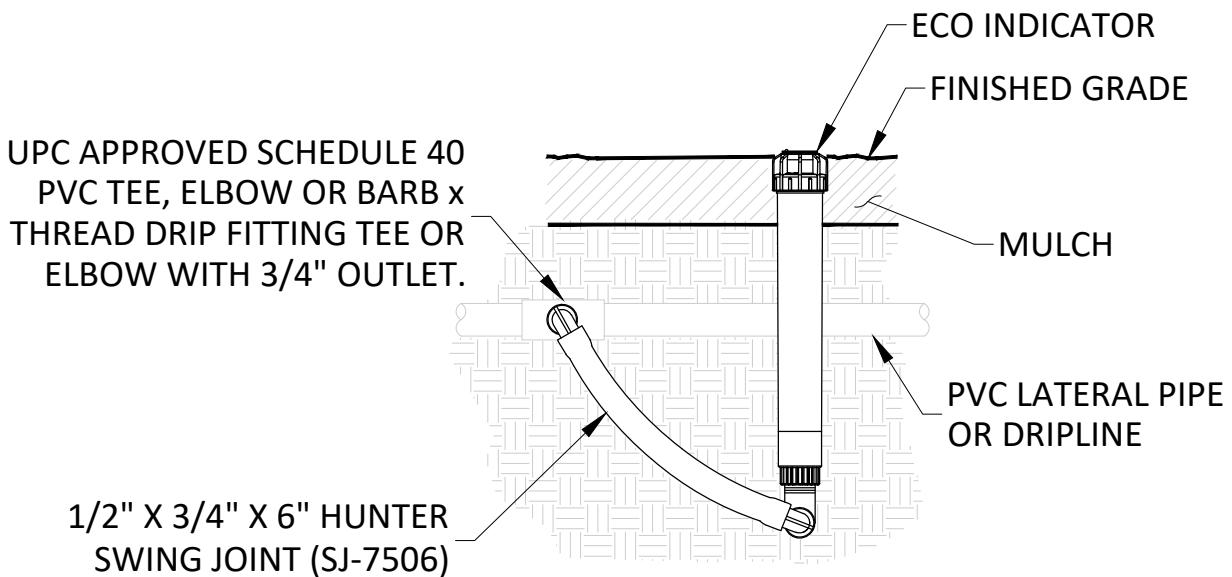

## DRIPLINE OPERATION INDICATOR

# CITY OF MILLBRAE \* STANDARD PLANS

NO.	REVISIONS	DATE	DRIPLINE STANDARDS					APPROVED			
DRAWN	CK	CHECKED	NT	DATE	03/2024	SCALE	NTS	SHEET	1 OF 2	DWG. NO.	<b>L-12.1</b>
										City Engineer	

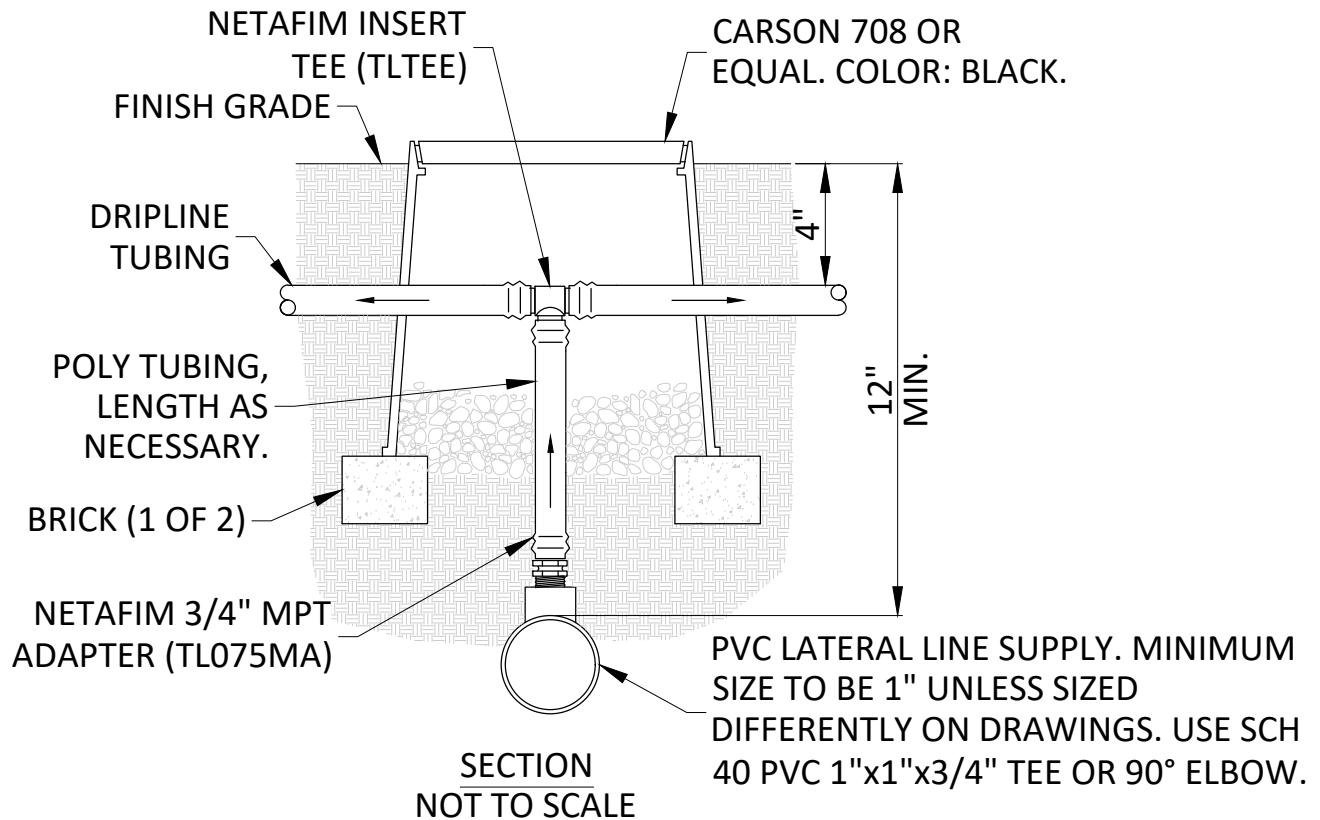

**NOTE:**

USE ONLY WHEN THE TOTAL LENGTH OF DRIP LINE SERVICED FROM THIS PVC CONNECTION IS LESS THAN 300 FT.

**DRILINE TO PVC CONNECTION-SINGLE SOURCE DRIP AREAS ONLY**

**CITY OF MILLBRAE \* STANDARD PLANS**

NO.	REVISIONS		DATE	DRIPLINE STANDARDS	APPROVED _____ City Engineer
DRAWN	CK	CHECKED	NT	DATE 03/2024	SCALE NTS
					SHEET 2 OF 2
DWG. NO. <b>L-12.2</b>					