
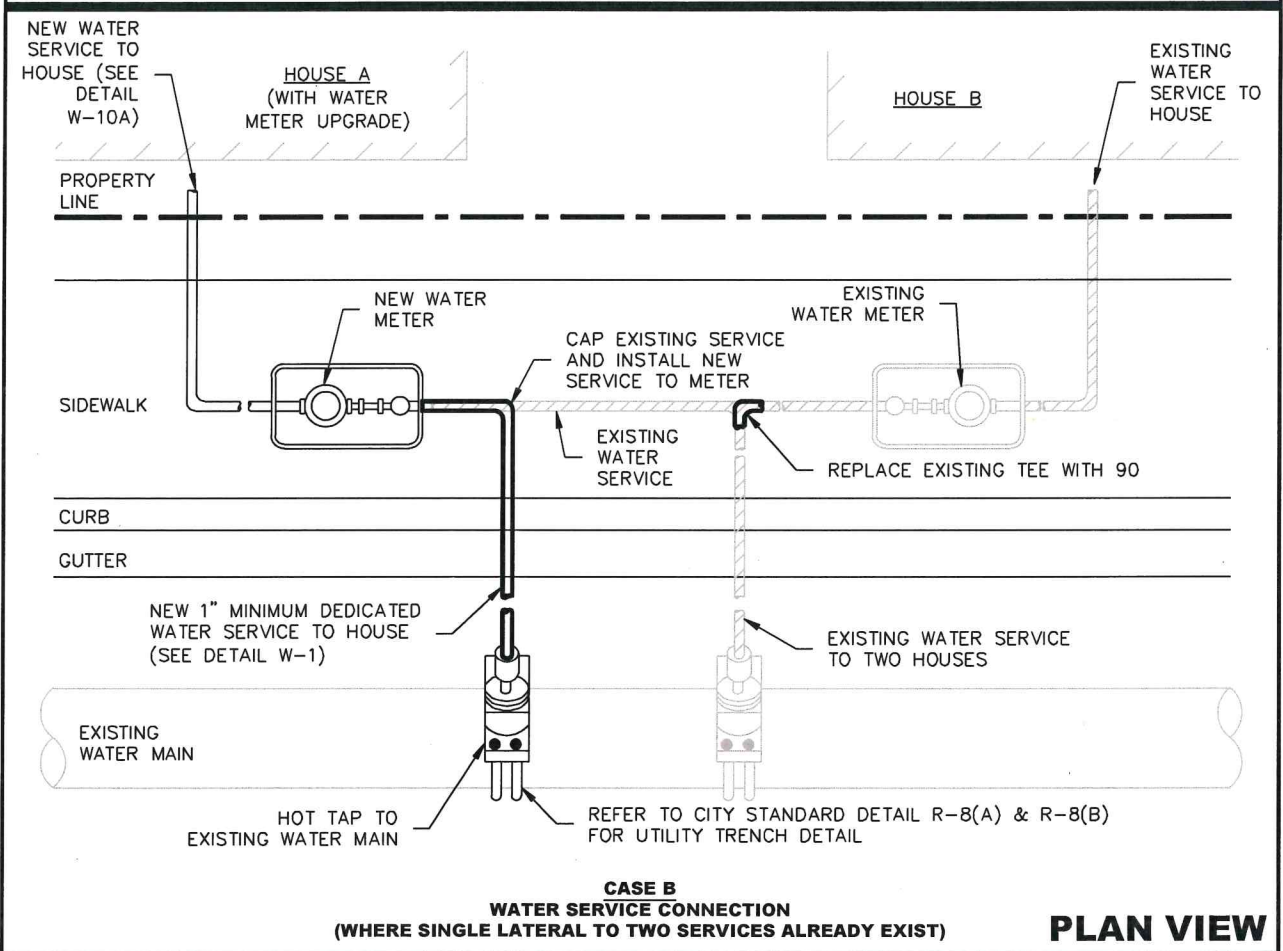


NOTES:

1. REFER TO STANDARD DETAIL W-1 FOR WATER SERVICE CONNECTION.
2. REFER TO STANDARD DETAIL W-4 FOR BACKFLOW PREVENTER ASSEMBLY.
3. REFER TO STANDARD DETAIL W-10B FOR REQUIREMENT OF SINGLE LATERAL FOR HOUSES WITH A FIRE SPRINKLER SYSTEM.
4. ALL BACKFLOW PREVENTER ASSEMBLIES MUST BE APPROVED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA (USC) AND TESTED BY A SAN MATEO COUNTY CERTIFIED TESTER BEFORE APPROVAL OF THE WATER SYSTEM. REFER TO THE SAN MATEO COUNTY WEB SITE FOR APPROVED LIST OF CERTIFIED TESTERS. FOR ADDITIONAL INFORMATION ON USC APPROVED DEVICES PLEASE CONTACT PUBLIC WORKS DEPARTMENT - UTILITIES & OPERATIONS AT (650) 259-2374.
5. TO DETERMINE THE WATER SERVICE AND METER SIZE, CONTACT PUBLIC WORKS DEPARTMENT - ENGINEERING AT (650) 259-2339.

CITY OF MILLBRAE * STANDARD PLANS

NO.	REVISIONS	DATE	TYPICAL RESIDENTIAL WATER SERVICE DETAIL (WITH FIRE SYSTEM)			APPROVED	 City Engineer			
DRAWN	AW	CHECKED	KL	DATE	1/15/21	SCALE	NONE	SHEET	1 OF 2	DWG. NO. W-10A

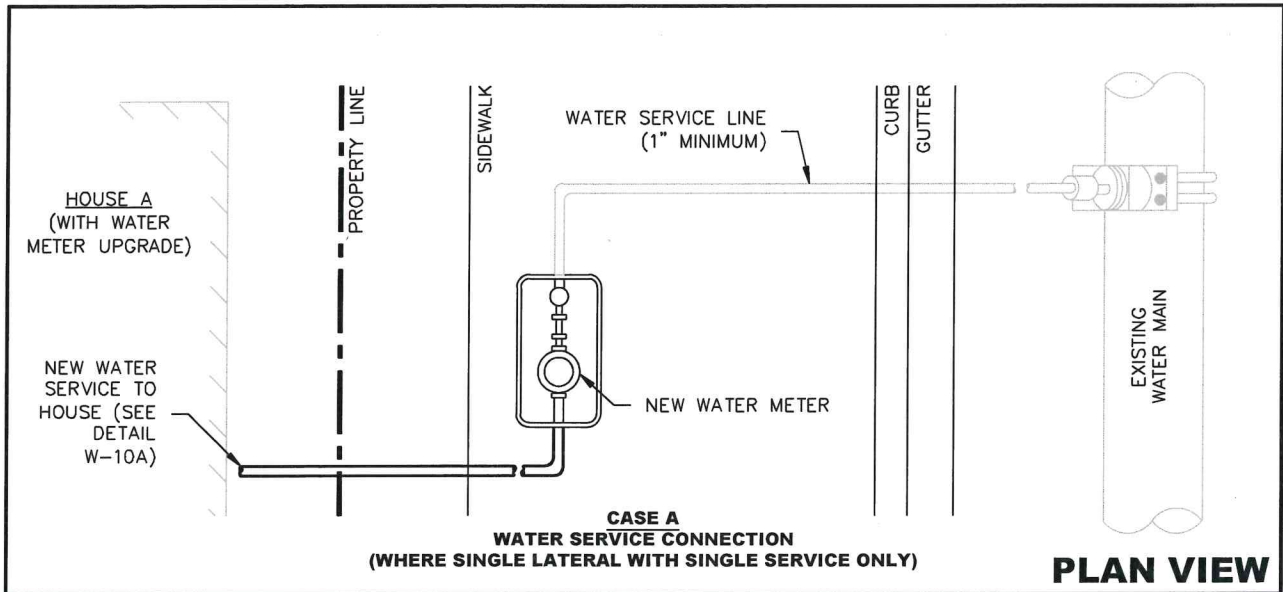

CITY OF MILLBRAE * STANDARD PLANS

NO.	REVISIONS	DATE	TYPICAL RESIDENTIAL WATER SERVICE DETAIL (WITH FIRE SYSTEM)			APPROVED					
						City Engineer					
DRAWN	AW	CHECKED	KL	DATE	1/15/21	SCALE	NONE	SHEET	2 OF 2	DWG. NO.	W-10B